



Most Widely Accepted and Trusted

ICC-ES Report

ESR-3071

ICC-ES | (800) 423-6587 | (562) 699-0543 | www.icc-es.org

Valid: 12/14 to 12/15

DIVISION: 06 00 00—WOOD, PLASTICS AND COMPOSITES
SECTION: 06 05 23.13—NAILS

REPORT HOLDER:

PASLODE, AN ILLINOIS TOOL WORKS COMPANY

888 FOREST EDGE DRIVE
VERNON HILLS, ILLINOIS 60061

EVALUATION SUBJECT:

PASLODE TetraGRIP™ NAILS



Look for the trusted marks of Conformity!

“2014 Recipient of Prestigious Western States Seismic Policy Council (WSSPC) Award in Excellence”



A Subsidiary of

ICC-ES Evaluation Reports are not to be construed as representing aesthetics or any other attributes not specifically addressed, nor are they to be construed as an endorsement of the subject of the report or a recommendation for its use. There is no warranty by ICC Evaluation Service, LLC, express or implied, as to any finding or other matter in this report, or as to any product covered by the report.



ICC-ES Evaluation Report**ESR-3071***

Reissued December 2014

This report is subject to renewal December 2015.www.icc-es.org | (800) 423-6587 | (562) 699-0543

A Subsidiary of the International Code Council®

**DIVISION: 06 00 00—WOOD, PLASTICS AND
COMPOSITES****Section: 06 05 23.13—Nails****REPORT HOLDER:****PASLODE, AN ILLINOIS TOOL WORKS COMPANY**
888 FOREST EDGE DRIVE
VERNON HILLS, ILLINOIS 60061
(847) 634-1900
www.paslode.com**EVALUATION SUBJECT:****PASLODE TetraGRIP™ NAILS****1.0 EVALUATION SCOPE****Compliance with the following codes:**

- 2012 *International Building Code*® (IBC)
- 2012 *International Residential Code*® (IRC)
- Other codes (see Section 8.0)

Properties evaluated:

- Compliance with requirements of ASTM F1667
- Bending yield strength
- Use in diaphragms

2.0 USES

Paslode TetraGRIP nails are used in engineered horizontal wood structural sheathing panel / sawn lumber floor diaphragm applications under the IBC as alternatives to the code-prescribed 10d common nails addressed in Tables 4.2A, 4.2B and 4.2C of the AF&PA Special Design Provisions for Wind and Seismic (SDPWS).

Paslode TetraGRIP nails are used as substitutes for 8d common nails in prescriptive floor diaphragms built in accordance with the IBC and IRC.

Paslode TetraGRIP nails are used as substitutes for the 10d common nails used in wood structural panel floor diaphragms supported on prefabricated wood I-joists recognized in ICC-ES evaluation reports.

3.0 DESCRIPTION**3.1 Paslode TetraGRIP Nails:**

Paslode TetraGRIP nails are nominally 0.113 inch (2.9 mm) in diameter and 2³/₈ inches (64 mm) long. The nails have a proprietary, helically threaded shank geometry

having barbed features on the helix. The head is a full round head 0.272 inch (6.9 mm) in diameter. See Figure 1 for an image of the fastener. The nails comply with the material requirements, physical properties, dimensional tolerances, workmanship, protective coating and finishes, and packaging requirements of ASTM F1667. The nails are manufactured from low-carbon steel wire, grade 1022. The nails are supplied in coils.

The Paslode TetraGRIP nails described in this report have a specified minimum bending yield strength, F_{yb} , of 120,000 psi (827 MPa).

3.2 Wood Structural Panels:

The wood structural panel subflooring used in the diaphragms must be Structural 1, Sheathing or Single-Floor grade panels complying with DOC PS-2.

3.3 Sawn Lumber Framing:

Sawn lumber framing must comply with the ANSI/AWC National Design Specification for Wood Construction (NDS).

3.4 I-joist Framing:

I-joist framing must be Boise Cascade BCI joists, recognized in [ESR-1336](#) for use in diaphragms; or Weyerhaeuser TJI joists recognized in [ESR-1153](#) for use in diaphragms.

4.0 DESIGN AND INSTALLATION**4.1 Design:**

4.1.1 General: Framing members and wood structural panel floor sheathing must be selected based on the spacing of the framing and the anticipated loads in accordance with the applicable code. Diaphragms described in this report are recognized for use in all Seismic Design Categories.

4.1.2 Prescriptive Floor Diaphragms: TetraGRIP nails may be directly substituted for the 8d common and 8d deformed nails prescribed in Item 31 of IBC Table 2304.9.1 and Items 33, 39 and 40 of IRC Table R602.3(1) for attaching wood structural panel sheathing to sawn lumber framing. The wood structural panel thickness must be a minimum of ²³/₃₂ inch (18.3 mm) and a maximum of ⁷/₈ inch (22.2 mm). The TetraGRIP nails may also be used in this manner when TJI joists are recognized as substitutions for sawn lumber framing, as shown for example in Section 4.14 of [ESR-1153](#).

4.1.3 Engineered Sawn Lumber Floor Diaphragms: TetraGRIP nails may be used to attach wood structural panel sheathing to sawn lumber framing to create floor

***Revised January 2015**

diaphragms. Allowable shear strengths for diaphragms consisting of wood structural sheathing panels attached to Douglas fir–larch or Southern pine lumber framing are shown in Tables 1 and 2, based on the values in SDPWS for 10d common nails and the thickest wood structural panels which are addressed. Allowable shear values for use with other wood species must be adjusted by factors noted in the corresponding footnote to each table.

Diaphragm deflection must be determined in accordance with Section 4.2.2 of SDPWS, using the applicable G_a value given in Tables 1 and 2, as applicable.

4.1.4 Engineered I-joint Floor Diaphragms: TetraGRIP nails may be used to attach sheathing to I-joint framing to create floor diaphragms, provided the I-joists meet the requirements of Section 3.4. Allowable shear values for these diaphragms are shown in Table 1 for nail spacing of 6 inches at diaphragm boundaries and panel edges, subject to the limitations shown in the ICC-ES evaluation report on the I-joists.

Diaphragm deflection must be determined in accordance with Section 4.2.2 of SDPWS, using the applicable G_a value given in Table 1.

4.2 Installation:

The nails must be installed in accordance with this evaluation report. Nail installation must also comply with applicable requirements in Section 11.1.5 of the NDS. The nails are driven either pneumatically or manually. The nails must be installed with minimum panel edge and end distances of $\frac{3}{8}$ inch (9.5 mm). Unless noted otherwise in an applicable I-joint evaluation report, use of glue between the sheathing panels and the floor framing is not required.

4.3 Special Inspection:

When special inspections are required by IBC Section 1705.10, periodic special inspection of nailing used in the construction of main windforce-resisting systems is required by IBC Section 1705.10.1 when the nail spacing is 4 inches (102 mm) or less.

When special inspections are required by IBC Section 1705.11, periodic special inspection of nailing used in the construction of seismic force-resisting systems is required by IBC Section 1705.11.2 when the nail spacing is 4 inches (102 mm) or less.

5.0 CONDITIONS OF USE

The Paslode TetraGRIP nails described in this report comply with, or are suitable alternatives to what is specified in, those codes listed in Section 1.0 of this report, subject to the following conditions:

- 5.1 Fasteners are installed in accordance with this report and the manufacturer's installation instructions. In the event of a conflict between this report and the manufacturer's installation instructions, this report governs.
- 5.2 Use of the TetraGRIP fasteners in connections and assemblies other than floor diaphragms is outside the scope of this report.
- 5.3 For engineered diaphragms, calculations showing that the applied loads are less than the allowable loads described in Section 4.1.3 and 4.1.4, as applicable, must be submitted to the code official. The calculations must be signed and sealed by a registered design professional when required by the statutes in the jurisdiction in which the project is to be constructed.

5.4 Use of TetraGRIP nails in diaphragms with I-joint framing, where the I-joint framing has not been recognized by ICC-ES for use in diaphragms, is outside the scope of this report.

5.5 TetraGRIP nails are produced at the Paslode manufacturing facility in Pocahontas, Arkansas, under a quality control program with inspections by ICC-ES.

6.0 EVIDENCE SUBMITTED

6.1 Data in accordance with the ICC-ES Acceptance Criteria for Nails and Spikes (AC116), dated June 2014.

6.2 Report of small scale screening test, full scale diaphragm tests, and analyses, in general accordance with the ICC-ES Acceptance Criteria for Prefabricated Wood I-joists (AC14) dated October 2013 (editorially revised February 2014).

7.0 IDENTIFICATION

The nails are packaged in cartons bearing labels that provide the manufacturer name (Paslode); nail description (type, length, and nominal diameter); the minimum bending yield strength (120,000 psi); and the evaluation report number (ESR-3071).

8.0 OTHER CODES

8.1 Scope:

In addition to the codes listed in Section 1.0, the Paslode TetraGRIP nails have been evaluated for compliance with the following codes:

- 2009 and 2006 *International Building Code*® (IBC)
- 2009 and 2006 *International Residential Code*® (IRC)

8.2 Uses:

See Section 2.0, except replace the first paragraph with the following: Paslode TetraGRIP nails are used in engineered horizontal wood structural sheathing panel / sawn lumber floor diaphragm applications as alternatives to the code-prescribed 10d common nails addressed under the 2009 IBC in SDPWS-08 Tables 4.2A, B and C; and under the 2006 IBC in 2006 IBC Table 2306.3.1 and SDPWS-05 Tables 4.2A and 4.2B.

8.3 Description:

See Section 3.0.

8.4 Design and Installation:

8.4.1 Design:

8.4.1.1 **General:** See Section 4.1.1.

8.4.1.2 **Prescriptive Floor Diaphragms:** TetraGRIP nails may be directly substituted for the 8d common nails prescribed in Item 31 of 2009 and 2006 IBC Table 2304.9.1; Items 41, 37 and 39 of 2009 IRC Table R602.3(1); and for similar connections in 2006 IRC Table R602.3(1) for attaching wood structural panel sheathing to sawn lumber framing. The wood structural panel thickness must be a minimum of $\frac{23}{32}$ inch (18.3 mm) and a maximum of $\frac{7}{8}$ inch (22.2 mm). The TetraGRIP nails may also be used in this manner when TJI joists are recognized as substitutions for sawn lumber framing, as shown for example in Section 4.14 of [ESR-1153](#).

8.4.1.3 **Engineered Sawn Lumber Floor Diaphragms:** TetraGRIP nails may be used to attach wood structural panel sheathing to sawn lumber framing to create floor diaphragms. Allowable shear strengths for diaphragms consisting of wood structural sheathing panels attached to

Douglas fir–larch or Southern pine lumber framing are shown in Tables 1 and 2, based on values in 2009 IBC Tables 2306.2.1(1) and 2306.2.1(2); 2006 IBC Tables 2306.3.1 and 2306.3.2; SDPWS-08 Tables 4.2A, 4.2B and 4.2C; and SDPWS-05 Tables 4.2A and 4.2B, for 10d common nails and the thickest wood structural panels which are addressed. Allowable shear values for use with other wood species must be adjusted by factors noted in the corresponding footnote to each table.

Diaphragm deflection must be determined in accordance with Section 4.2.2 of SDPWS, using the applicable G_a value given in Tables 1 and 2, as applicable.

8.4.1.4 Engineered I-joist Floor Diaphragms: TetraGRIP nails may be used to attach sheathing to I-joist framing to create floor diaphragms, provided the I-joists meet the requirements of Section 3.4. Allowable shear values for these diaphragms are shown in Table 1 for nail spacing of 6 inches at the diaphragm boundaries and panel edges, subject to the limitations shown in the ICC-ES evaluation report on the I-joists.

8.4.2 Installation:
See Section 4.2.

8.4.3 Special Inspection

When special inspections are required by 2009 IBC Section 1706.1, periodic special inspection of nailing used in the construction of main windforce-resisting systems is required by 2009 IBC Section 1706.2 when the nail spacing is 4 inches (102 mm) or less.

When special inspections are required by 2009 and 2006 IBC Section 1707.1, periodic special inspection of nailing used in the construction of seismic force-resisting systems is required 2009 and 2006 IBC Section 1707.3 when the nail spacing is 4 inches (102 mm) or less.

8.5 Conditions of Use:

See Section 5.0.

8.6 Evidence Submitted:

See Section 6.0.

8.7 Identification:

See Section 7.0.

TABLE 1—ALLOWABLE UNIT SHEAR STRENGTH, v_a , AND APPARENT DIAPHRAGM SHEAR STIFFNESS, G_a , FOR WIND OR SEISMIC LOADING (POUNDS PER FOOT) FOR WOOD STRUCTURAL PANEL HORIZONTAL DIAPHRAGMS WITH FRAMING OF DOUGLAS FIR-LARCH OR SOUTHERN PINE^{1,2,3}

SHEATHING THICKNESS (inch) AND TYPE	NAIL	MINIMUM WIDTH OF FRAMING MEMBERS (inches)	BLOCKED DIAPHRAGMS								UNBLOCKED DIAPHRAGMS			
			Nail spacing (inch) at diaphragm boundaries (all cases), at continuous panel edges parallel to load (Cases 3 & 4), and at all panel edges (Cases 5 & 6)								Fasteners spaced 6 inches maximum at supported edges			
			6 ⁴		4		2 ^{1/2}		2		Case 1 (No unblocked edges or continuous joints parallel to load)		All other configurations (Cases 2, 3, 4, 5 and 6)	
			Nail spacing at other panel edges (Cases 1, 2, 3 and 4)											
			6 ⁴		6		4		3					
v_a	G_a	v_a	G_a	v_a	G_a	v_a	G_a	v_a	G_a	v_a	G_a	v_a	G_a	
	OSB		OSB		OSB		OSB		OSB		OSB		OSB	
23/32" and 3/4" Sheathing and Single Floor OSB	TetraGrip	2	320	15.8	425	26.3	640	44.2	730	59.0	285	17.9	215	13.5
		3	360	13.9	480	23.2	720	39.2	820	52.7	320	15.8	240	11.8

See Notes below Table 2.

TABLE 2—ALLOWABLE UNIT SHEAR STRENGTH, v_a , AND APPARENT DIAPHRAGM SHEAR STIFFNESS, G_a , FOR WIND OR SEISMIC LOADING (POUNDS PER FOOT) FOR WOOD STRUCTURAL PANEL HORIZONTAL DIAPHRAGMS WITH FRAMING OF DOUGLAS FIR-LARCH OR SOUTHERN PINE AND MULTIPLE ROWS OF FASTENERS (HIGH LOAD DIAPHRAGMS)^{1,2,3,5}

SHEATHING THICKNESS (inch) AND TYPE	NAIL	MINIMUM NOMINAL WIDTH OF NAILED FACE AT ADJOINING PANEL EDGES AND BOUNDARIES (inches)	MINIMUM WIDTH OF FRAMING MEMBERS (inches)	BLOCKED DIAPHRAGMS							
				Nail spacing (inch) at diaphragm boundaries (all cases), at continuous panel edges parallel to load (Cases 3 & 4), and at all panel edges (Cases 5 & 6)							
				4		4		2 1/2		2 1/2	
				Nail spacing at other panel edges (Cases 1, 2, 3 and 4)							
				6		4		4		3	
v_a		G_a		v_a		G_a		v_a		G_a	
		OSB				OSB				OSB	
23/32" and 3/4" Structural I OSB	TetraGrip	3	2	730	23.9	955	35.8	1,050	58.3	1,365	50.3
		4	2	855	20.4	1,070	32.5	1,210	54.0	1,565	46.0
		4	3	1,050	16.4	1,430	25.0	1,525	46.8	1,800	41.7
23/32" and 3/4" Sheathing and Single Floor OSB	TetraGrip	3	2	710	24.4	935	36.0	1,020	58.0	1,335	50.1
		4	2	825	21.0	1,050	32.7	1,175	53.9	1,445	47.7
		4	3	1,020	16.9	1,400	25.3	1,480	47.0	1,565	45.3

Notes for Tables 1 and 2:

For SI: 1 inch = 25.4 mm, 1 pound per foot = 14.6 N/m.


¹Diaphragms must be constructed in general accordance with the requirements of Section 4.2 of ANSI/AF&PA SDPWS-08.

²Tabulated values are for short-time loading due to wind or seismic. For use with the IBC, the tabulated values must be reduced by 37 percent and 44 percent for normal and permanent load duration, respectively, and may be increased by 40 percent for wind design.

³The tabulated values are for fasteners installed in Douglas Fir-larch or Southern Pine. For other species, the allowable unit shear values must be reduced by multiplying value by the following adjustment factor: Specific Gravity Adjustment Factor = [1 - (0.5 - G)], where G = Specific Gravity of the framing lumber from Table 11.3.3A of the NDS-12 (Table 11.3.2A of the NDS-05). This adjustment factor must not be greater than 1.

⁴Values are applicable to I-joint diaphragm, as described in Section 4.1.4.

⁵Cases are described below:

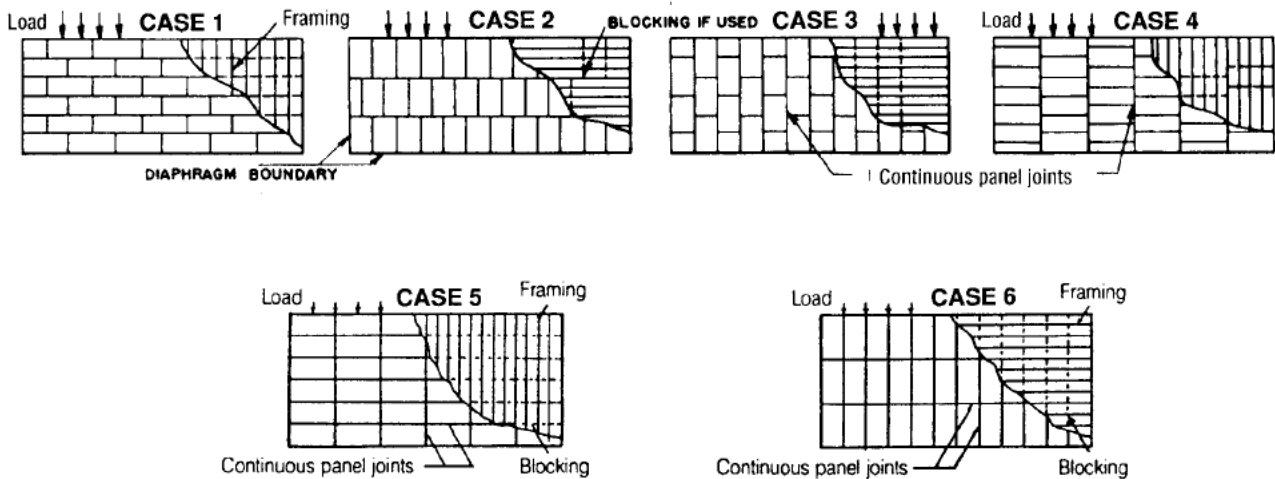

NOTE: Framing orientation in either direction for diaphragms is permitted provided sheathing is properly designed for vertical loading.



FIGURE 1—TETRAGRIP NAIL

ICC-ES Evaluation Report**ESR-3071 FBC Supplement**

Issued December 2014

This report is subject to renewal December 2015.

www.icc-es.org | (800) 423-6587 | (562) 699-0543

A Subsidiary of the International Code Council®

DIVISION: 06 00 00—WOOD, PLASTICS AND COMPOSITES
Section: 06 05 23.13—Nails**REPORT HOLDER:****PASLODE, AN ILLINOIS TOOL WORKS COMPANY**
888 FOREST EDGE DRIVE
VERNON HILLS, ILLINOIS 60061
(847) 634-1900
www.paslode.com**EVALUATION SUBJECT:****PASLODE TetraGRIP™ NAILS****1.0 REPORT PURPOSE AND SCOPE****Purpose:**

The purpose of this evaluation report supplement is to indicate that Paslode TetraGRIP™ nails, recognized in ICC-ES master evaluation report ESR-3071, have also been evaluated for compliance with the codes noted below.

Applicable code editions:

- 2010 *Florida Building Code—Building*
- 2010 *Florida Building Code—Residential*

2.0 CONCLUSIONS

The Paslode TetraGRIP™ nails, described in Sections 2.0 through 7.0 of the master evaluation report ESR-3071, complies with the 2010 *Florida Building Code—Building* and 2010 *Florida Building Code—Residential*, provided the design and installation are in accordance with the 2009 *International Building Code*® (IBC) provisions noted in the master report and the following condition:

For prescriptive floor diaphragms as noted in Section 8.4.1.2 of the master report, TetraGRIP nails may be directly substituted for the 8d common nails prescribed in Item 31 of Table 2304.9.1 of the 2010 Florida Building Code – Building. The wood structural panel thickness must be a minimum of $2\frac{3}{32}$ inch (18.3 mm) and a maximum of $\frac{7}{8}$ inch (22.2 mm).

Use of the Paslode TetraGRIP™ nails for compliance with the High-Velocity Hurricane Zone provisions of the 2010 *Florida Building Code—Building* and 2010 *Florida Building Code—Residential* has not been evaluated, and is outside the scope of this supplemental report.

For products falling under Florida Rule 9N-3, verification that the report holder's quality assurance program is audited by a quality assurance entity approved by the Florida Building Commission for the type of inspections being conducted is the responsibility of an approved validation entity (or the code official when the report holder does not possess an approval by the Commission).

This supplement expires concurrently with the master report, reissued December 2014, revised January 2015.